


# T-29 TF-25 T-25 ASSEMBLY DIAGRAM

01	CENTRAL HEATING STOVE
02	CHIMNEY OUTPUT
03	ELECTRICITY AND TEMPERATURE INDICATOR
04	CIRCULATION PUMP
05	VALVES
06	FILLING VALVE
07	RADIATOR HOT WATER INPUT
08	RADIATOR COLD WATER OUTPUT
09	RADIATOR VALVE
10	RADIATOR
11	DRAIN VALVE
12	POWER SUPPLY
13	MECHANICAL THERMOSTAT
14	VENTILATION COVER
15	EXPANSION VESSEL
16	MANOMETER
17	SAFTY VALVE
18	WATER INPUT
19	HOT WATER OUTPUT
20	TEMPERATURE SAFETY VALVE
21	TEMPERATURE SAFETY VALVE DISCHARGE
22	AUTOMATIC AIR DISCHARGE DEVICE

THIS DRAWING IS A SAMPLE, IT CAN BE CHANGED ACCORDING TO THE PLACE WHERE IT IS INSTALLED. PRODUCT MUST BE INSTALLED BY AN AUTHORIZED PERSON.

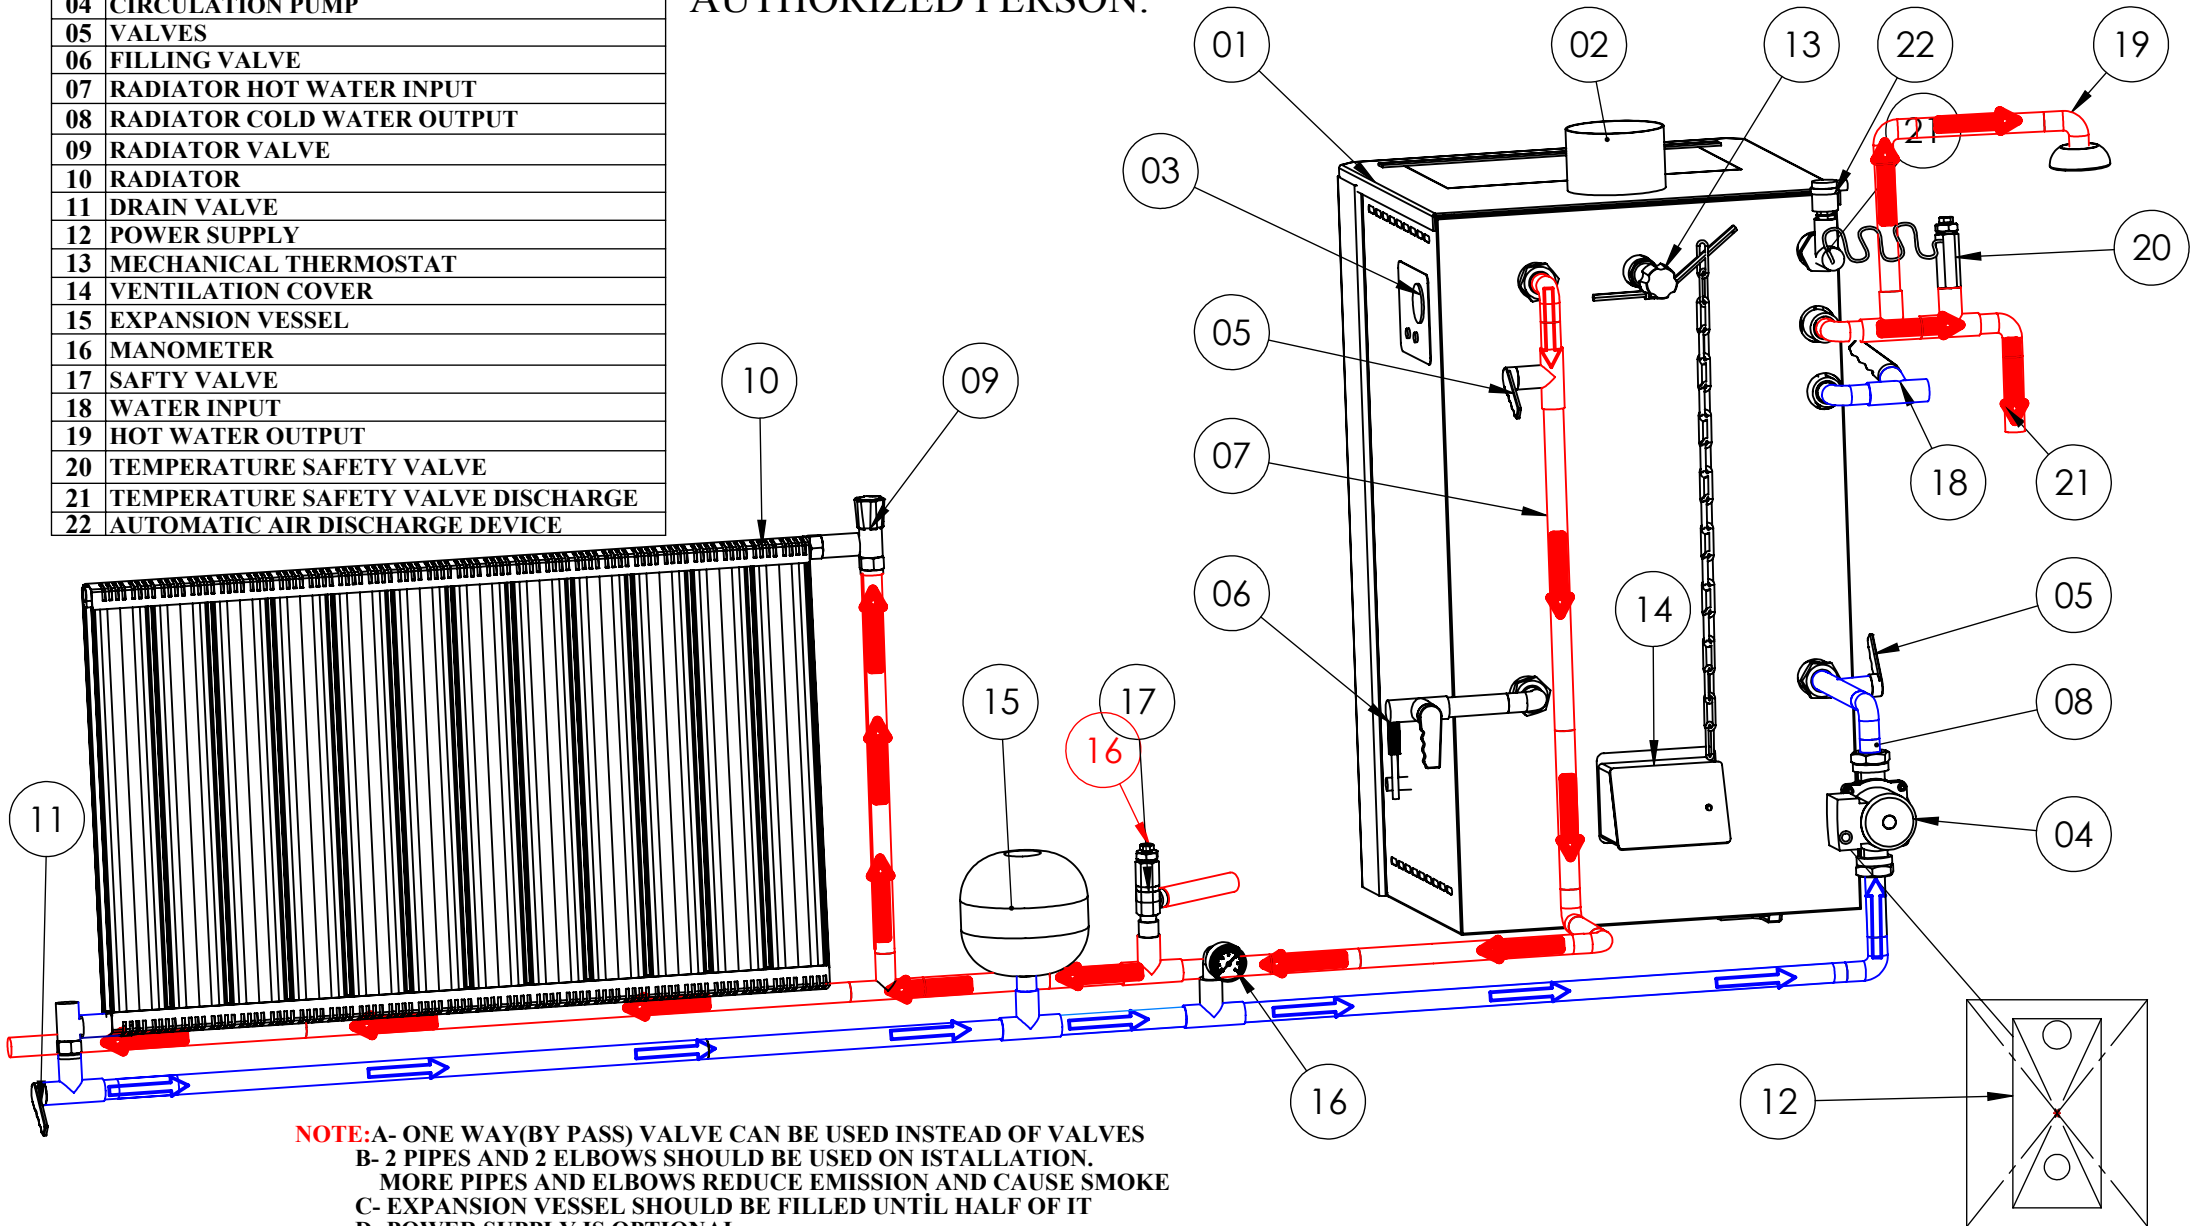

**NOTE:**  
A- ONE WAY (BY PASS) VALVE CAN BE USED INSTEAD OF VALVES  
B- 2 PIPES AND 2 ELBOWS SHOULD BE USED ON INSTALLATION.  
C- MORE PIPES AND ELBOWS REDUCE EMISSION AND CAUSE SMOKE  
D- EXPANSION VESSEL SHOULD BE FILLED UNTIL HALF OF IT  
E- POWER SUPPLY IS OPTIONAL  
F- STOVE AND PIPES SHOULD BE CLEANED ONCE A WEEK  
G- ASH TRAY SHOULD BE CLEANED EVERYDAY  
H- ANTI-FREEZE™ (1/3) AGAINST CORROSION AND FOR BETTER PERFORMANCE.  
I- THERMOSTATICAL SAFETY VALVE SHOULD BE USED ON THIS KIND OF INSTALLATION.  
OTHERWISE, OUR COMPANY IS NOT RESPONSIBLE FOR ANY DAMAGE.